NO SCALE

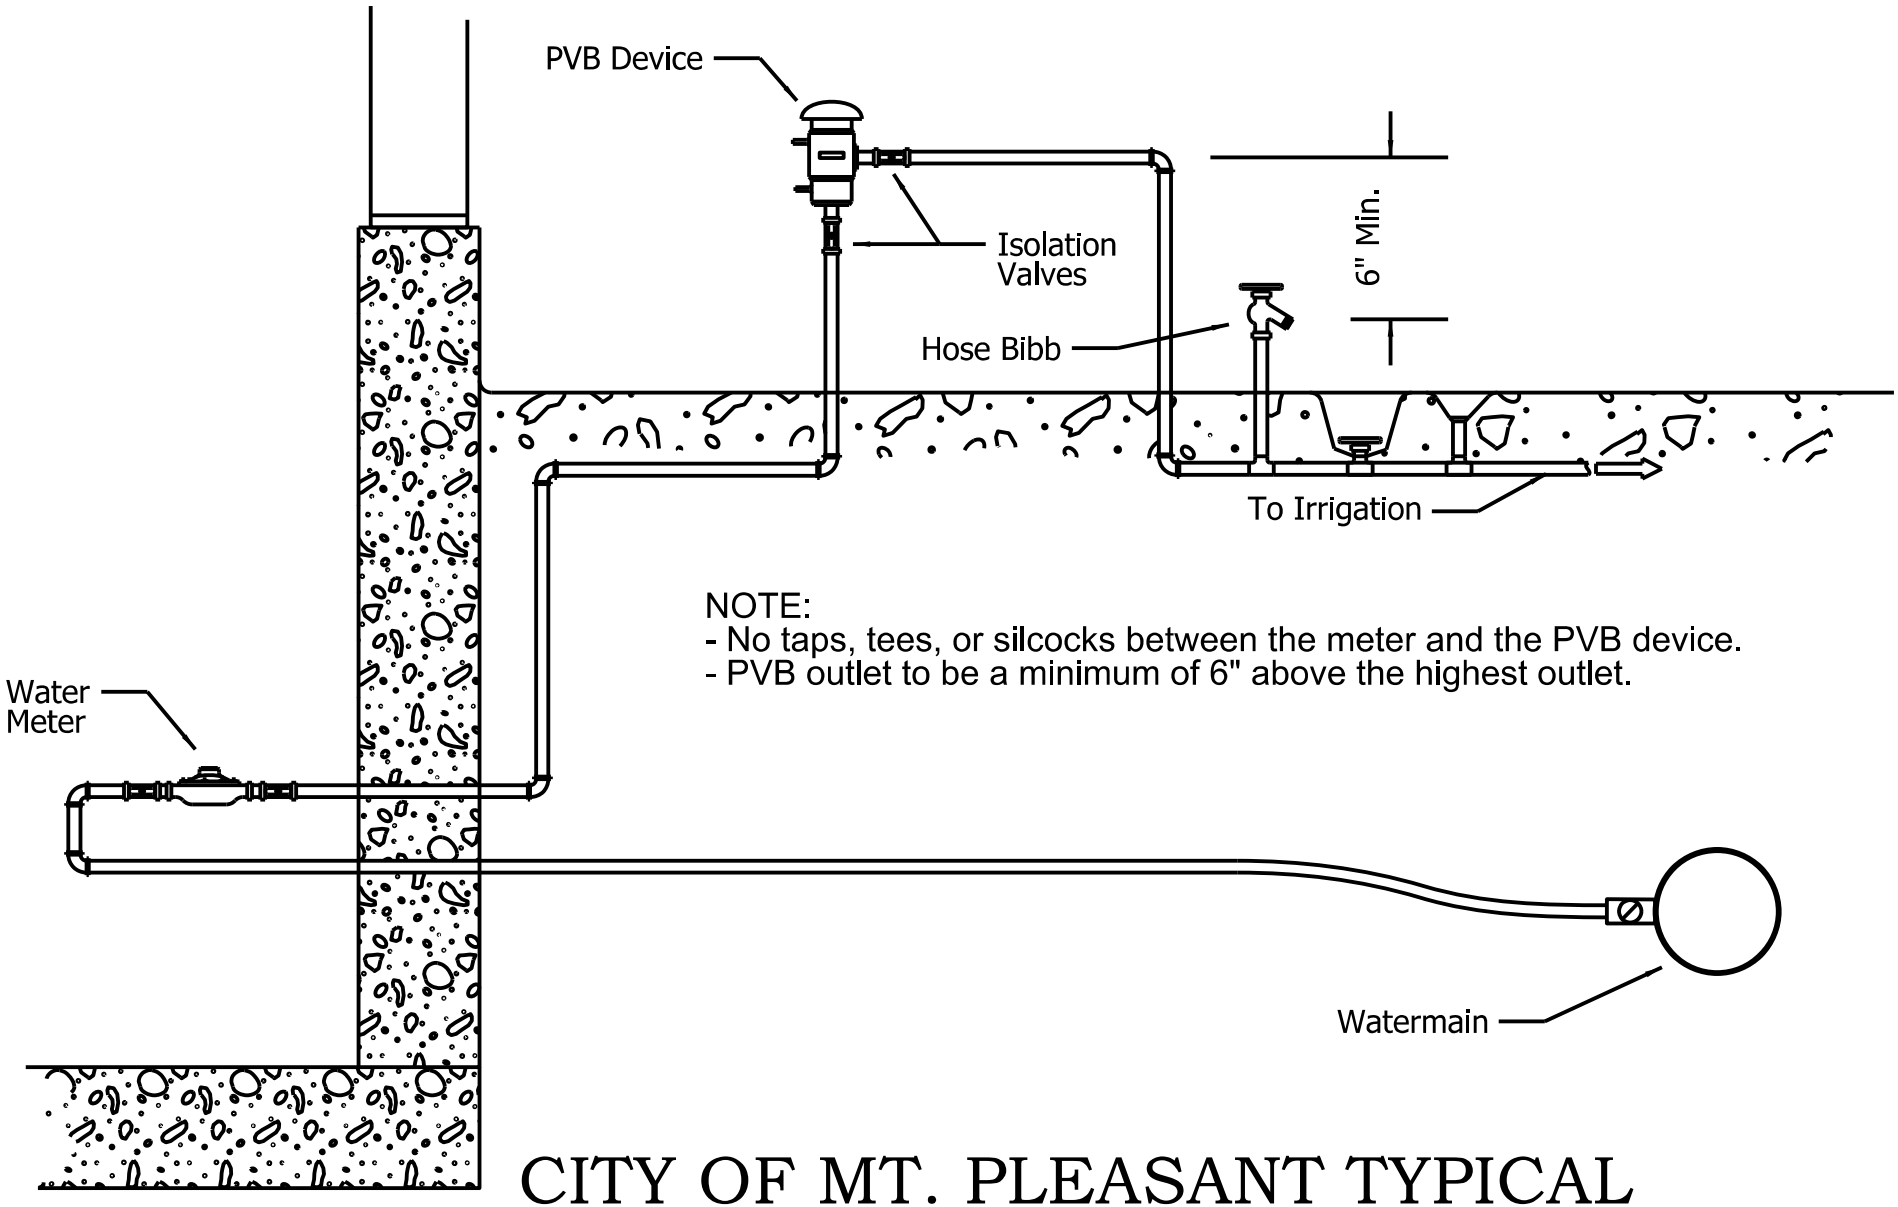

NOTE:
- No taps, tees, or silcocks between the meter and the PVB device.
- PVB outlet to be a minimum of 6" above the highest outlet.

CITY OF MT. PLEASANT TYPICAL PRESSURE VACUUM BREAKER (PVB) CONFIGURATION